



CONTROL HUMIDISTAT PRE-SET AT 50%  
ALARM HUMIDISTAT PRE-SET AT 70%

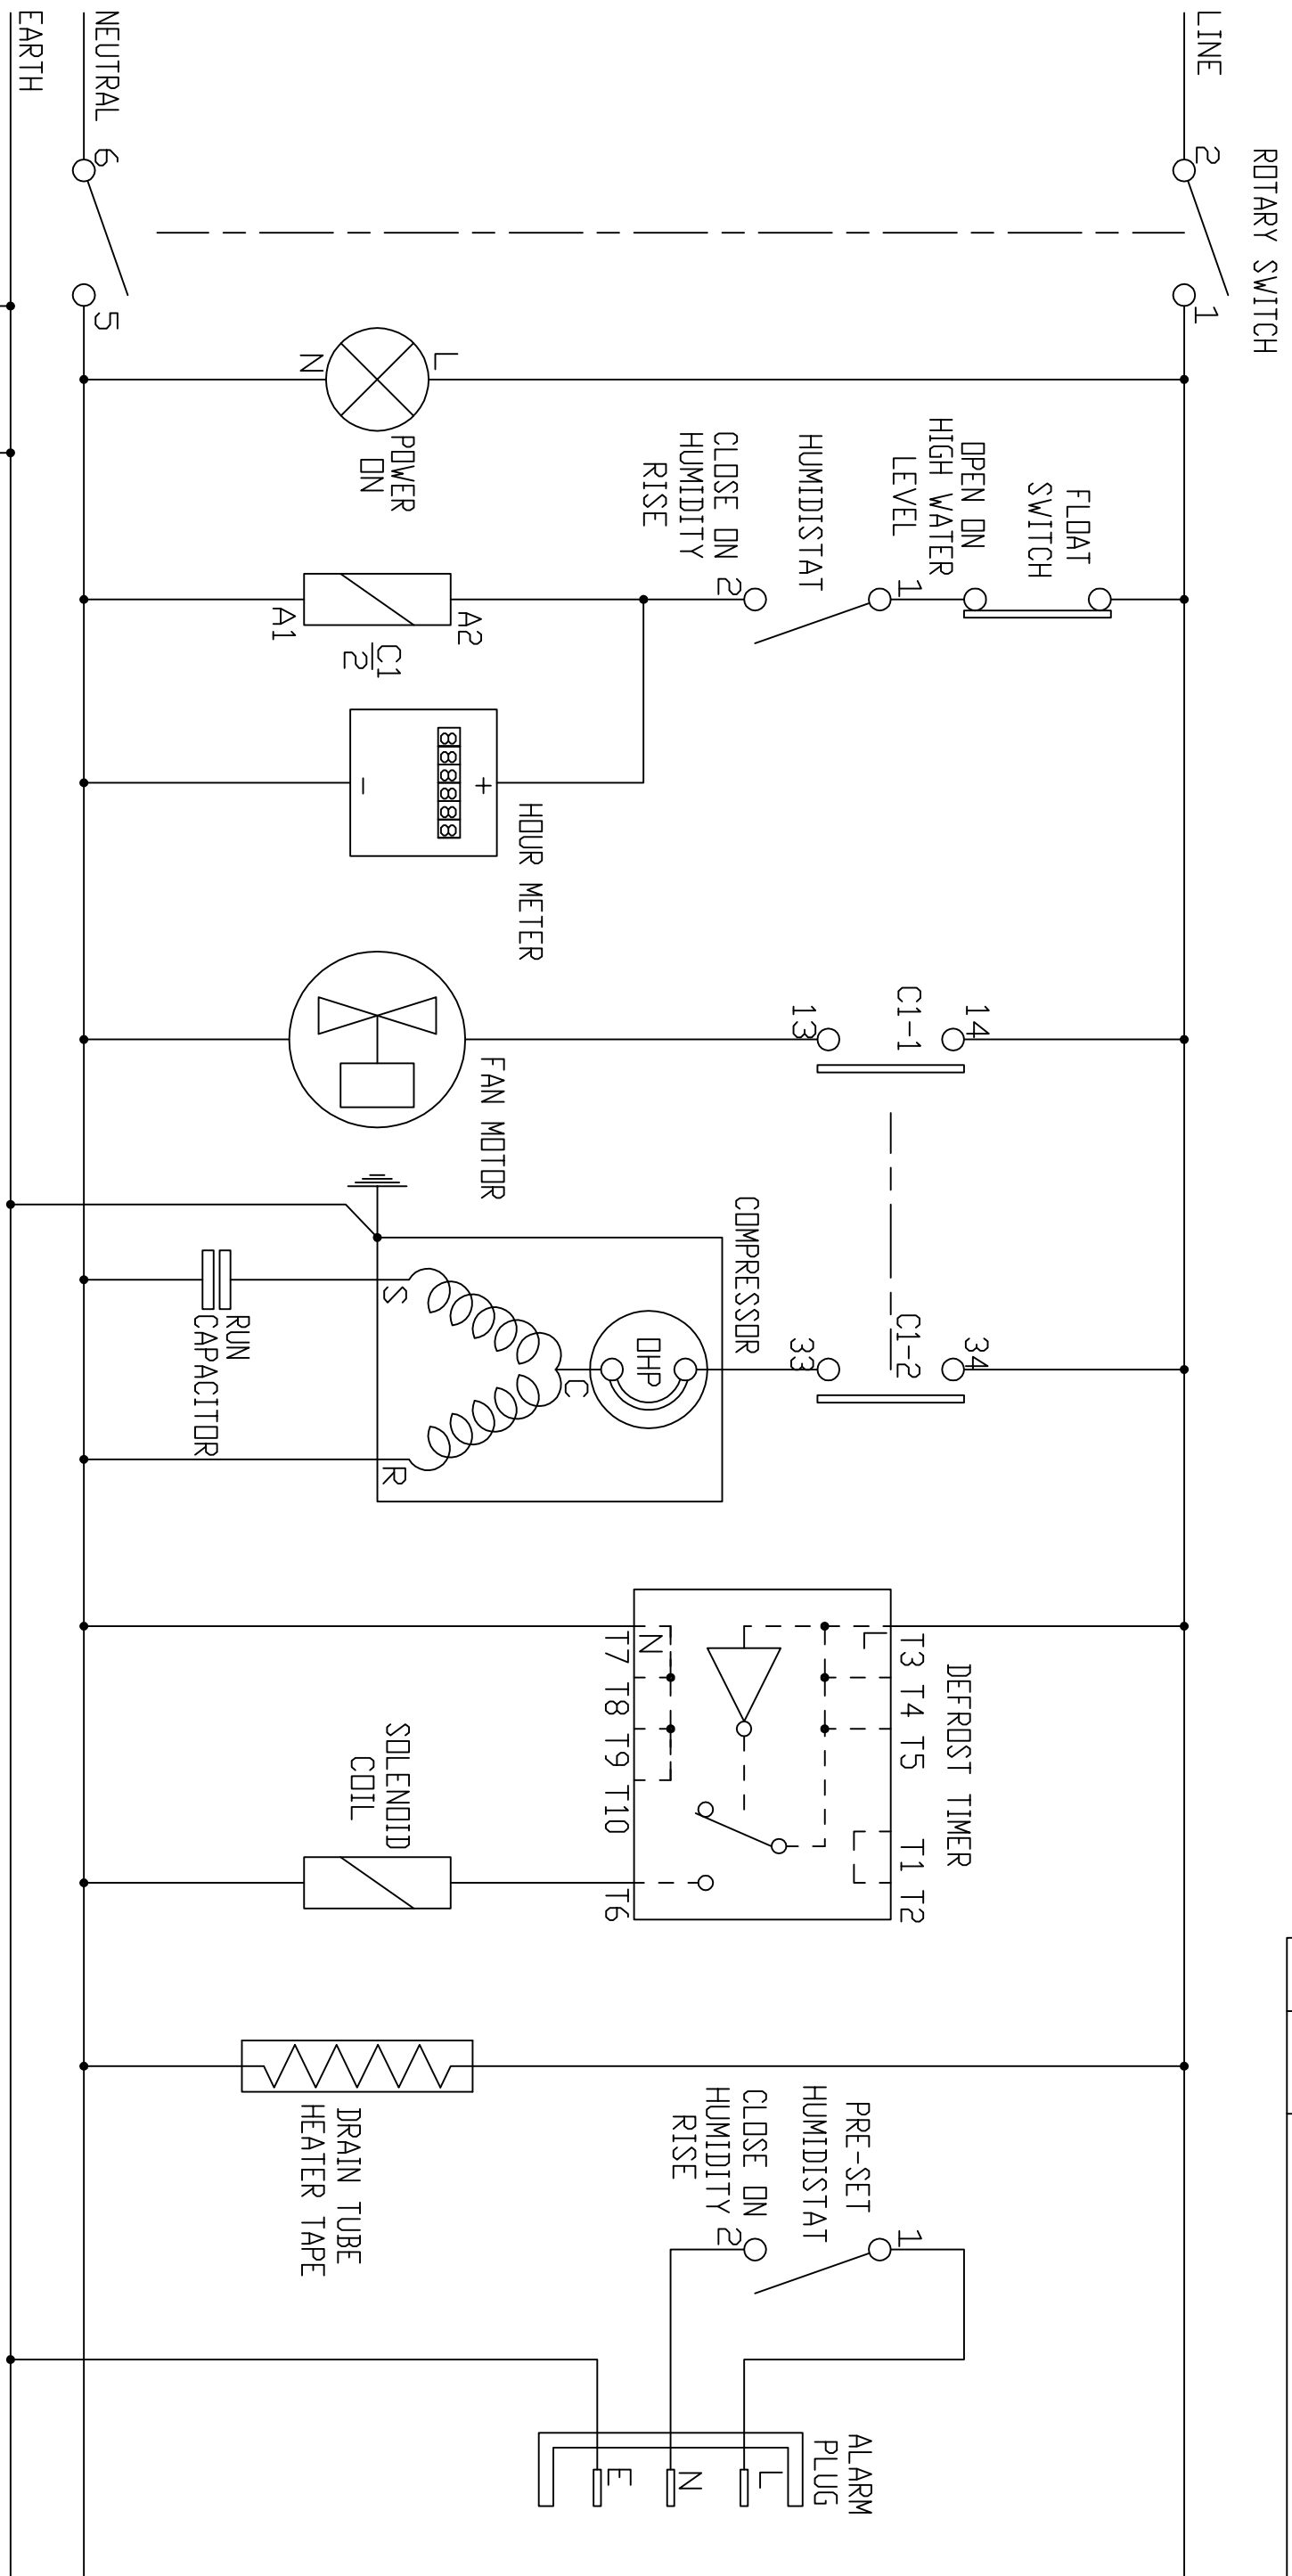

ISSUE	DATE	AMENDMENTS
1	17/10/96	ORIGINAL
2	13/05/97	HUMIDISTAT INFORMATION ADDED - MTD



1993  
LIMITED  
BISHOP AUCKLAND  
ENGLAND

**TITLE**  
WIRING SCHEMATIC  
FOR CD100E

**MATERIAL**  
FINISH

**DRAWN :** MICHAEL DUNN  
CAD SCALE : 1/1

3RD ANGLE PROJECTION  
DD NOT SCALE  
IF IN DOUBT ASK

DIMENSIONS IN mm.  
TOLERANCES UNLESS  
OTHERWISE STATED

0	+ 1
0.0	± 0.25
0.00	± 0.05
ANGULAR	± 0.5 DEGREE

**DRG.ND**  
5020172

**SHEET**  
1 OF 1